



MAS2 Controller version 7	Hand / 0 / Auto - door switch	low water contact	PTC	Run signal	active fan	heater
2 Pumps unit with:						

3 Phase Power supply

L1/ L2/ L3

1 Phase Power supply

L1/ N

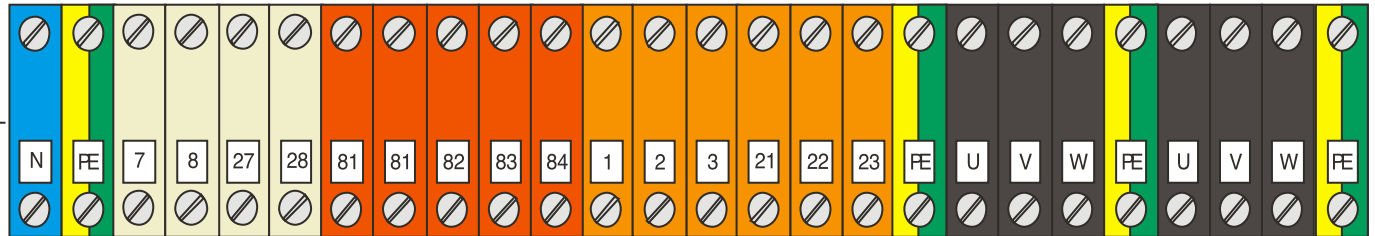

Steuerklemmen:	5VDC	24VDC	Steuerklemmen:	24VDC	230VAC	Steuerklemmen:	24VDC	230VAC
			81 + 24VDC	X				
			81 + 24VDC	X				
			82 - 0 VDC	X				
			83 - Transducer Signal P1 10V	X				
			84 - Transducer Signal P2 10V	X				
7 external Start / Stop		X	1 Relay p.f. common P1		X			
8 external Fix Speed / Reset		X	2 Relay p.f. closer P1		X			
27 external Start / Stop		X	3 Relay p.f. opener P1		X			
28 external Fix Speed / Reset		X	21 Relay p.f. common P1		X			
			22 Relay p.f. closer P1		X			
			23 Relay p.f. opener P1		X			



Harzer Strasse 10
49124 Georgsmarienhütte
Tel.: +49(0)5401-8388-0

Gez.: S. Mausch

Änd.:

Date: 15.10.2014

Created: U. Molitor